


Digitales Eingangsmodul

LF-DI230

11086313

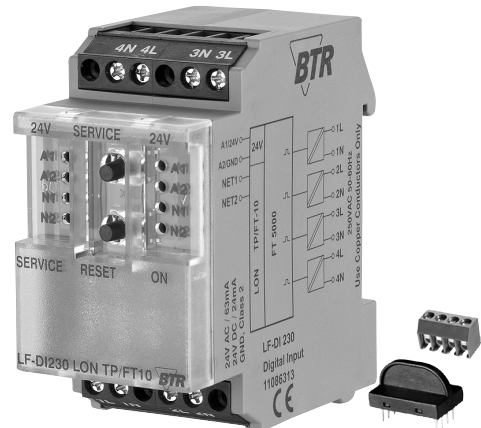

899301-25

1. Beschreibung

LON-Modul mit 4 digitalen Eingängen für dezentrale Schaltaufgaben. Es ist geeignet zur Erfassung von 230 Volt AC Schaltzuständen, z.B. Schalter oder Taster zur Lichtsteuerung. Die Eingangsklemmen 1L bis 4L können mit den Klemmen 1N bis 4N durch 230 Volt AC Schalter oder Kontakte beschaltet werden.

2. Wichtige Hinweise

Konformitätserklärung

Das Gerät wurde nach den geltenden Normen geprüft. Die Konformität wurde nachgewiesen. Die Konformitätserklärung ist beim Hersteller BTR NETCOM GmbH abrufbar.

Hinweise zur Gerätebeschreibung

Die Beschreibung enthält Hinweise zum Einsatz und zur Montage des Geräts. Sollten Fragen auftreten, die nicht mit Hilfe dieser Anleitung geklärt werden können, sind weitere Informationen beim Lieferanten oder Hersteller einzuholen.

Die angegebenen Vorschriften/Richtlinien zur Installation und Montage gelten für die Bundesrepublik Deutschland. Beim Einsatz des Geräts im Ausland sind die nationalen Vorschriften in Eigenverantwortung des Anlagenbauers oder des Betreibers einzuhalten.

Sicherheitshinweise

Für die Montage und den Einsatz des Geräts sind die jeweils gültigen Arbeitsschutz-, Unfallverhütungs- und VDE-Vorschriften einzuhalten.

Facharbeiter oder Installateure werden darauf hingewiesen, dass sie sich vor der Installation oder Wartung der Geräte vorschriftsmäßig entladen müssen.

Montage- und Installationsarbeiten an den Geräten dürfen grundsätzlich nur durch qualifiziertes Fachpersonal durchgeführt werden, siehe Abschnitt "qualifiziertes Fachpersonal".

Jede Person, die das Gerät einsetzt, muss die Beschreibungen dieser Anleitung gelesen und verstanden haben.

Warnung vor gefährlicher elektrischer Spannung

Gefahr

bedeutet, dass bei Nichtbeachtung Lebensgefahr besteht, schwere Körperverletzungen oder erhebliche Sachschäden auftreten können.

Qualifiziertes Fachpersonal

Qualifiziertes Fachpersonal im Sinne dieser Anleitung sind Personen, die mit den beschriebenen Geräten vertraut sind und über eine ihrer Tätigkeit entsprechenden Qualifikation verfügen.

Hierzu gehören zum Beispiel:

- Berechtigung zum Anschluss des Geräts gemäß den VDE-Bestimmungen und den örtlichen EVU-Vorschriften sowie Berechtigung zum Ein-, Aus- und Freischalten des Geräts unter Berücksichtigung der innerbetrieblichen Vorschriften;
- Kenntnis der Unfallverhütungsvorschriften;
- Kenntnisse über den Einsatz und Gebrauch des Geräts innerhalb des Anlagensystems usw.

3. Technische Daten

LON-Schnittstelle

Übertragung	TP/FT-10 free topology
Neuron	FT5000
Datenformat	Standardnetzwerkvariablen (SNVT)
Übertragungsrate	78 kBit/s
Max. Länge	
Linientopologie	2700 m / 64 Knoten
beliebige Topologie	500 m / 64 Knoten
Verkabelung	Twisted Pair

Applikationssoftware

XIF- und NXE-Files können aus dem Internet unter www.metz-connect.com heruntergeladen werden.

Versorgung

Betriebsspannungsbereich	20 ... 28 V AC/DC (SELV)
Stromaufnahme	63 mA (AC) / 21 mA (DC)
Einschaltdauer relativ	100 %
Wiederbereitstellungszeit	550 ms

Eingangsseite

Eingang 4 x Digital-Spannungseingang 230 V

Gehäuse

Abmessungen BxHxT	35 x 70 x 65 mm
Gewicht	72 g
Einbaulage	beliebig
Montage	Tragschiene TH35 nach IEC 60715
Anreihbar ohne Abstand	Nach dem Anreihen von 15 Modulen oder einer maximalen Stromaufnahme von 2 A (AC oder DC) pro Anschluss am Netzgerät muss mit der Versorgungsspannung neu extern angefahren werden.

Material

Gehäuse	Polyamid 6.6 V0
Klemmen	Polyamid 6.6 V0
Blende	Polycarbonat

Schutzart (IEC 60529)

Gehäuse	IP40
Klemmen	IP20

Anschlussklemmen

Versorgung und Bus	
4-polige Anschlussklemme	max. 1,5 mm ² eindrätig max. 1,0 mm ² feinstdrätig
Aderndurchmesser	0,3 mm bis max. 1,4 mm (Anschlussklemme und Brückenstecker als Zubehör in der Verpackung)

Geräteanschluss

digitale Eingänge	max. 4 mm ² eindrätig max. 2,5 mm ² feinstdrätig
Aderndurchmesser	0,3 mm bis max. 2,7 mm
Schutzbeschaltung	Verpolschutz der Betriebsspannung Verpolschutz von Speisung und Bus


Temperaturbereich

Betrieb	-5 °C ... +55 °C
Lagerung	-20 °C ... +70 °C


Anzeige

Funktion und Status	grüne LED, gelbe LED
---------------------	----------------------


4. Prinzipbild

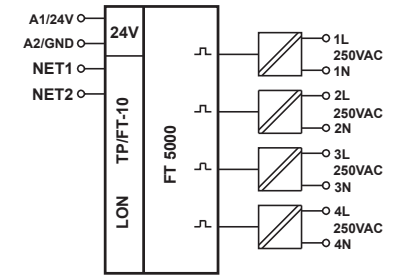

5. Anschlussbild



6. Anzeige- und Bedienelemente



- 1 Service-Taste mit gelber LED
- 2 Reset-Taste mit grüner LED (Betriebsanzeige)
- 3 4 gelbe LEDs - Zustandsanzeige der Eingänge

7. Montage


Anlage spannungsfrei schalten

Gerät auf Tragschiene (TH35 nach IEC 60715, Einbau in Elektroverteiler / Schalttafel) setzen


Installation

Die Elektroinstallation und der Geräteanschluss dürfen nur durch qualifiziertes Fachpersonal unter Beachtung der VDE-Bestimmungen und örtlicher Vorschriften vorgenommen werden..


Anschlussklemme für Busanschluss einstecken.

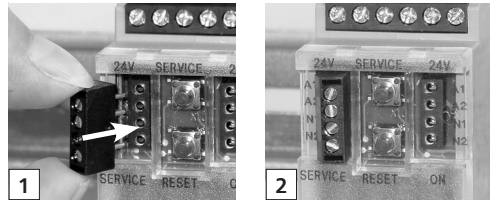

Kabel für Busanschluss anschließen

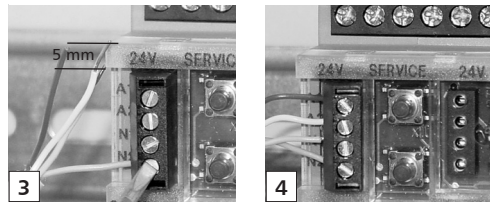

Reihenmontage

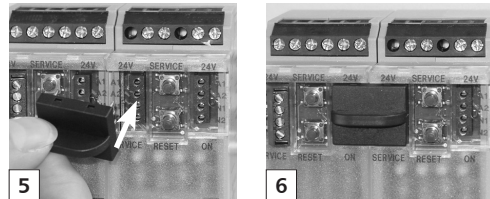


Das Modul ist ohne Abstand anreihbar. Bei Reihenmontage Brückenstecker aufstecken, er verbindet Bus und Versorgungsspannung bei nebeneinander montierten Modulen.

Nach dem Anreihen von 15 Modulen oder einer maximalen Stromaufnahme von 2 A (AC oder DC) pro Anschluss am Netzgerät muss mit der Versorgungsspannung neu extern angefahren werden.

8. Beschreibung der Software

Node Object

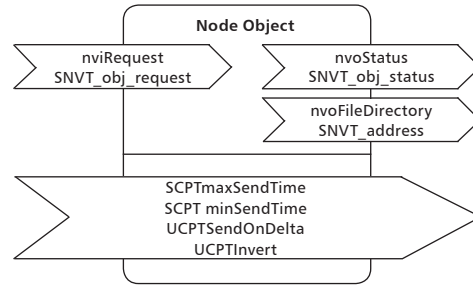

Das Node Object überwacht und steuert die Funktionen der einzelnen Objekte im Gerät. Unterstützt werden die von LonMark geforderten Grundfunktionen Object-Status und Object-Request.

nviRequest SNVT_obj_request
nvoStatus SNVT_obj_status
nvoFileDirectory SNVT_address

SCPTmaxSendTime SNVT_time_sec

Alle unten beschriebenen Ausgangsvariablen werden auch ohne Zustandsänderung nach Ablauf einer eingestellten Zeit ausgegeben.

Gültige Werte: 0 Timer abgeschaltet
 6553 s (Werkseinstellung 60 s)

SCPTminSendTime SNVT_time_sec

Zwei aufeinanderfolgende Zustandsänderungen werden erst nach Ablauf der eingestellten minSendTime ausgegeben.

Gültige Werte: 0 Timer abgeschaltet
 6553 s (Werkseinstellung 1 s)

UCPTSendOnDelta SNVT_count


Der Zählerstand wird nur ausgegeben, wenn die eingestellte Differenz zum vorherigen Wert erreicht ist.

UCPTInvert SNVT_state

Invertierung der Eingangssignale
 UCPTInvert.bit[0...3] = 0 Kontakt geschlossen;
 nvoDiValue_1...4 gesetzt.

UCPTInvert.bit[0...3] = 1 Kontakt offen;
 nvoDiValue_1...4 gesetzt.

DigitalIn_1 - 4 Objects

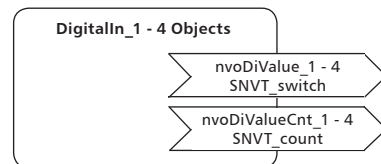

nvoDiValue_1...4 SNVT_switch


Status der Eingänge bei UCPTInvert = 0
 Kontakt geschlossen nvoDiValue_1...4 = 100,0 1
 Kontakt offen nvoDiValue_1...4 = 0,0 0

nvoDiValueCnt_1...4 SNVT_count

Zähler der positiven Impulsflanken am Eingang.
 Reset-Wert = 65535; 1. Zählwert = 1

Fortsetzung Beschreibung der Software

Virtual Function Block

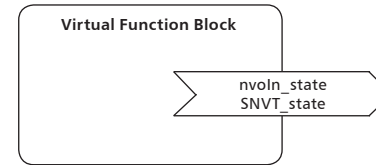

nvoIn_state

Status der Eingänge

Zuordnung:

nvoIn_state.bit0 = input 1...bit3 = input 4

Kontakt geschlossen nvoIn_state.bit[0...3] = 1

Kontakt offen nvoIn_state.bit[0...3] = 0


SNVT_state

Digital input module

LF-DI230

11086313

899301-25

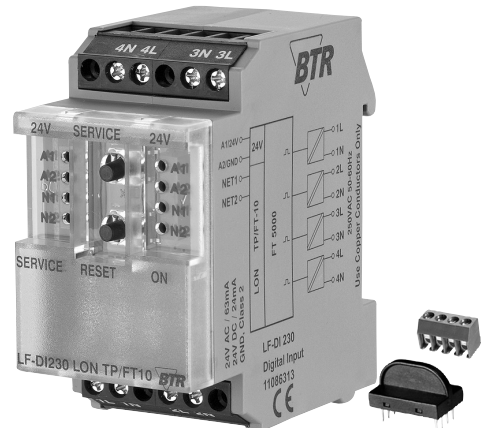

1. Description

LON module with 4 digital inputs for decentralized switching operations. It is suitable to record 230 Volt AC switch states, as for example electrical switches or buttons for light control. The input terminals 1L to 4L can be connected to the terminals 1N to 4N by 230 volts AC switches or contacts.

2. Declaration of Conformity

The device was tested according to the applicable standards. Conformity was proofed. The declaration of conformity is available at the manufacturer BTR NETCOM GmbH.

Notes Regarding Device Description

These instructions include indications for use and mounting of the device. In case of questions that cannot be answered with these instructions please consult supplier or manufacturer.

The indicated installation directions or rules are applicable to the Federal Republic of Germany. If the device is used in other countries it applies to the equipment installer or the user to meet the national directions.

Safety Instructions

Keep the applicable directions for industrial safety and prevention of accidents as well as the VDE rules.

Technicians and/or installers are informed that they have to electrically discharge themselves as prescribed before installation or maintenance of the devices.

Only qualified personnel shall do mounting and installation work with the devices, see section "qualified personnel".

The information of these instructions have to be read and understood by every person using this device.

Symbols

Warning of dangerous electrical voltage

Danger

means that non-observance may cause risk of life, grievous bodily harm or heavy material damage.

Qualified Personnel

Qualified personnel in the sense of these instructions are persons who are well versed in the use and installation of such devices and whose professional qualification meets the requirements of their work.

This includes for example:

- Qualification to connect the device according to the VDE specifications and the local regulations and a qualification to put this device into operation, to power it down or to activate it by respecting the internal directions.
- Knowledge of safety rules.
- Knowledge about application and use of the device within the equipment system etc.

3. Technical Data

LON interface

Transceiver	TP/FT-10 free topology
Neuron	FT5000
Data format	standard network variables (SNVT)
Transmission rate	78 kBit/s
Max. length	
line topology	2700 m / 64 nodes
free topology	500 m / 64 nodes
Cabling	Twisted Pair

Application software

XIF and NXE files are available as downloads at www.metz-connect.com.

Supply

Operating voltage range	20 ... 28 V AC/DC (SELV)
Current consumption	63 mA (AC) / 21 mA (DC)
Duty cycle relative	100 %
Recovery time	550 ms

Input

Input 4 x Digital voltage input 230 V

Housing

Dimensions WxHxD 1.378 x 2.756 x 2.559 in. (35 x 70 x 65 mm)

Weight 72 g

Mounting position any

Mounting standard rail TH35 per IEC 60715

Mounting in series without space

The maximum quantity of modules connected in line is limited to 15 or to a maximum power consumption of 2 Amps (AC or DC) per connection to the power supply. For any similar block of additional modules a separate connection to the power supply is mandatory.

Material

housing	polyamide 6.6 V0
terminal blocks	polyamide 6.6 V0
Cover plate	polycarbonate

Type of protection (IEC 60529)

housing	IP40
terminal blocks	IP20

Terminal blocks

Supply and bus	
4 pole terminal block	max. AWG 16 (1.5 mm ²) solid wire max. AWG 18 (1.0 mm ²) stranded wire min. 0.3 mm up to max. 1.4 mm (terminal block and jumper plug are included to each packing unit)
Wire diameter	

Module connection	
digital inputs	max. AWG 12 (4.0 mm ²) solid wire max. AWG 14 (2.5 mm ²) stranded wire min. 0.3 mm up to max 2.7 mm
Wire diameter	
Protective circuitry	polarity reversal protection of operating voltage polarity reversal protection of supply and bus


Temperature range

Operation	23° F to 131° F (-5 °C to +55 °C)
Storage	-4° F to +158° F (-20 °C to +70 °C)


Indication

Operation	green LED
Function	yellow LED for status (service)
Status of the inputs	yellow LEDs


4. Wiring Diagram

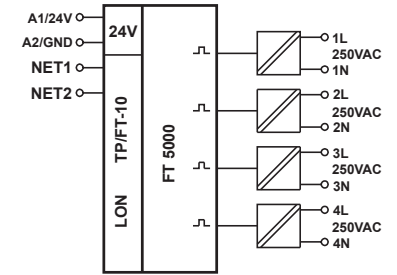

5. Connecting Diagram



6. Display and Operating Elements



- 1 Service button and yellow LED
- 2 Reset button and green LED (operating indication)
- 3 4 yellows LEDs - Indication of the input status

7. Mounting


Power down the equipment

Mount the module on standard rail (TH35 per IEC 60715 in junction boxes and/or on distribution panels).


Installation

Electric installation and device termination shall be done by qualified persons only, by respecting all applicable specifications and regulations.


Plug in the terminal block for bus connection

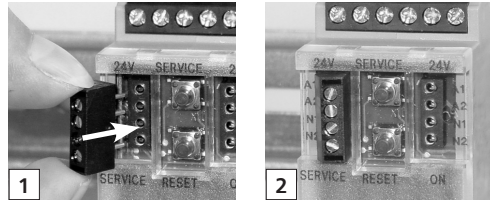

Connect the cable for bus supply

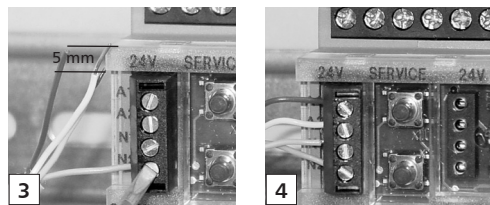

Mounting in series

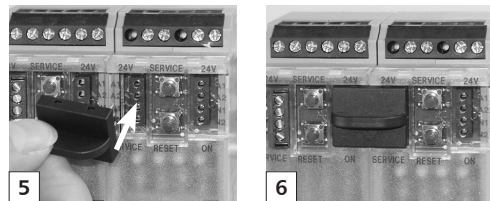


The module can be aligned without interspace. Use the jumper plug to connect bus and supply voltage when the modules are mounted in series.

The maximum quantity of modules connected in line is limited to 15 or to a maximum power consumption of 2 Amps (AC or DC) per connection to the power supply. For any similar block of additional modules a separate connection to the power supply is mandatory.

8. Software Description

Node Object

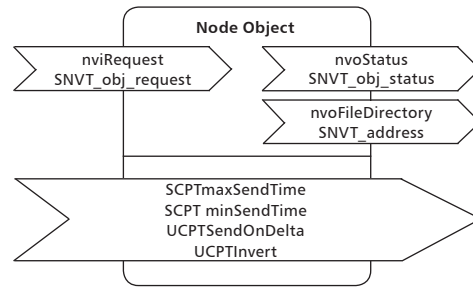

The Node Object monitors and controls the functions of the different objects in the device. It supports the basic functions Object-Status and Object-Request required by LonMark.

nviRequest SNVT_obj_request
nvoStatus SNVT_obj_status
nvoFileDirectory SNVT_address

SCPTmaxSendTime SNVT_time_sec

All output variables described below will be issued at the latest at the end of the preset period even without status change.

Value range: 0 timer deactivated
 6553 s (factory setting 60 s)

SCPTminSendTime SNVT_time_sec

Two successive status changes will not be issued before the end of the preset minSendTime.

Value range: 0 timer deactivated
 6553 s (factory setting 1 s)

UCPTSendOnDelta SNVT_count

The counter reading will only be issued when a preset counter difference to the previously issued value is reached.

UCPTInvert SNVT_state


Inverting of input signals

UCPTInvert.bit[0...3] = 0 contact closed;
 nvoDiValue_1...4 set.

UCPTInvert.bit[0...3] = 1 contact open;
 nvoDiValue_1...4 set.

Continuation Software Description

DigitalIn_1 - 4 Objects

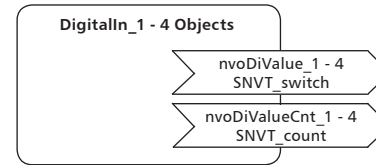

nvoDiValue_1...4 SNVT_switch

Status of the inputs at UCPTInvert = 0

Contact closed nvoDiValue_1...4 = 100.0 1


Contact open nvoDiValue_1...4 = 0.0 0

nvoDiValueCnt_1...4 SNVT_count

Counter of the positive impulse edges at the input.

Reset value = 65535; 1. counted measurand = 1.

Virtual Function Block

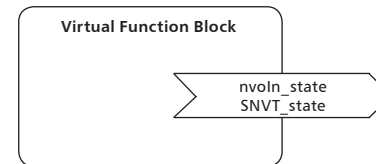

nvoln_state SNVT_state

Status of the inputs.

Assignment:

nvoln_state.bit0 = input 1...bit3 = input 4

Contact closed nvoln_state.bit[0...3] = 1

Contact open nvolnstate.bit[0...3] = 0