

# SR65 AKF 868 MHz

Wireless Air Duct Temperature Sensor

thermokon®  
Sensortechnik GmbH

250511

## Datasheet

Subject to technical alteration  
Issue date: 25.02.2016



## Application

Self-powered wireless EnOcean duct sensor to measure the temperature in gaseous media of heating, ventilation and air-conditioning systems. Configuration via airConfig.

## Security Advice – Caution



The installation and assembly of the device should only be performed by authorized personnel.

The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

## Notes on Disposal



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

## Guidelines for Devices with Solar Energy Storage

Due to the energy-optimized EnOcean radio technology used in "EasySens" wireless sensors, the devices can work without batteries and self-charge themselves using electric energy generated by integrated solar cells. This makes the devices almost maintenance free and environmentally sound due to not having to replace batteries.

For optimum use, the device should be mounted in a location with sufficient ambient brightness. Minimum illumination of 200 lx (artificial light or ambient) is required for at least 3 to 4 hours each day. (The health and safety regulations at work require a minimum illumination of 500 lx for office workplaces).

The solar cell should be mounted facing towards the window direction if possible. If the device has a temperature sensor, then even periodic direct sun radiation should be avoided due to incorrect false temperature readings.

The mounting position should be selected so that the device will not be obstructed in the future: for example by placement areas, additional furniture or roll-fronted cupboards.

The sensor is supplied in an operational state. If the sensor has been stored in darkness for longer periods, the internal solar energy storage will most likely need to be recharged. This would normally happen automatically during commissioning or during initial start up in ambient light. If the initial charge is not sufficient, the sensor will reach its full operating state up to 3 to 4 days, if the requirements for minimum illumination per day are met. The sensor will then transmit continuously in darkness as specified f (2/3 days on factory default telegram timing). Depending on the application it is also possible for the devices to operate in darker rooms (with brightness <100 lx) by using the battery back-up option. Batteries to be used are listed in accessories.

The operating time when using batteries will depend on the transmission frequency as well as the component aging and the self-discharge of the battery. Standard operating time will be 5-10 years on factory default telegram timing. Changing of the device from solar to battery operation is done automatically by simply adding a battery to the device.

## Information about EasySens (Radio) / airConfig in general

See Information: [http://www.thermokon.de/ftp/info/Information\\_Radio\\_airConfig\\_en.pdf](http://www.thermokon.de/ftp/info/Information_Radio_airConfig_en.pdf)



## Technical Data

Radio technology	EnOcean (IEC 14543-3-10)
Frequency	868 MHz
Power supply	Solar cell, internal super cap optional: battery LS14250
Measuring range temp	+10..+90 °C, Configured via airConfig
Accuracy temperature	±1% of measuring range (typ. at 21 °C)
Transmission interval	Configured via airConfig, Default: Wake-up time =100 sec. Heartbeat cycle = 10x
Enclosure	PA6, colour pure white, upper housing material PC, transparent, quick lock screws
Protection	IP65 according to EN 60529
Pocket	Stainless steel 1.4571, Ø=7 mm, L=135 mm
Ambient condition	-25..+65 °C, max. 93% rH, non-condensing
Weight:	140g
Notes	Additional probe lengths available on request, integrated battery backup possibility for usage in dark rooms

## Overview of airConfig selectable radio telegrams

<b>A5-02-17 (standard)</b>					
A5-02-01	A5-02-02	A5-02-03	A5-02-04	A5-02-05	A5-02-06
A5-02-07	A5-02-08	A5-02-09	A5-02-0A	A5-02-0B	A5-02-10
A5-02-11	A5-02-12	A5-02-13	A5-02-14	A5-02-15	A5-02-16
A5-02-18	A5-02-19	A5-02-1A	A5-02-1B	A5-02-20	A5-02-30

### EEP:

Whish data contained in the telegram is in the EEP (EnOcean equipment profile) defined <http://www.enocean-alliance.org/EEP/>.

# Configuration with airConfig

NO airConfig needed if default settings will be used. airConfig and a EnOcean USB transceiver (i.e. USB300) will be mandatory if the default EEP and other settings shall be changed.

The screenshot shows the 'Settings' window in the airConfig software. It is divided into two main sections: 'Device information' and 'Device settings'.  
 In the 'Device information' section, there are two fields: 'Firmware version' with the value '1.00' and 'Energy status' with the value 'n/a'.  
 The 'Device settings' section is titled 'EEP' and contains a dropdown menu currently set to 'A5-02-01, Temperature Sensor Range -40°C to 0°C'. Below this are several other settings:  
 - 'Temperature at byte value 0' is set to '0.0'.  
 - 'Temperature at byte value' has a dropdown set to '255' and a corresponding value of '-40.0'.  
 - 'Change of value' is set to '0.16 °C'.  
 - 'Temperature offset' is set to '0.0'.  
 - 'Wake-up time' is set to '10 sec'.  
 - 'Heartbeat cycle' is set to 'every 10th WakeUp'.

On the top there are some informations like the **Firmware version** and the **Energy status** of the device.

It is necessary to ensure that the device is full charged or a battery is inserted. The Energy status must be **OK** to configure the device.

Clicking on the drop-down menu **EEP** to choose the desired measuring range. The corresponding **Byte values** of the Temperature values are shown below.



**Attention:** Only operate the sensor in the specified temperature range.


**Change of value** defines the minimal temperature change required since the last transmission to send a new telegram.

Set **Temperature offset** for individual adjustment.

The **Wake-up** time defines the measuring interval.

**Heartbeat cycle** defines the maximal number of Wake-ups without transmitting the temperature between 2 transmissions. Receivers monitor this interval to detect missing sensor signals.


Right-click on the device icon and send configuration to initiate the transfer of the new settings. As the sensor will be sleeping it will need to be woken up by pressing the LRN button. Once the configuration has been transferred successfully into the device the sensor will be highlighted in green. Highlighted in Red indicates a problem during the transmission.

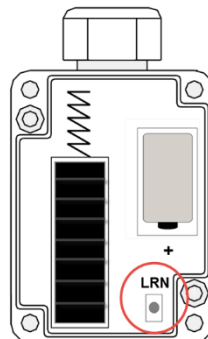

**Note:**

The more frequently a device is programmed to wake up, measure and send data, the more energy is being consumed, which can lead to insufficient energy charge of the sensor by ambient illumination.

## Dimensions (mm)

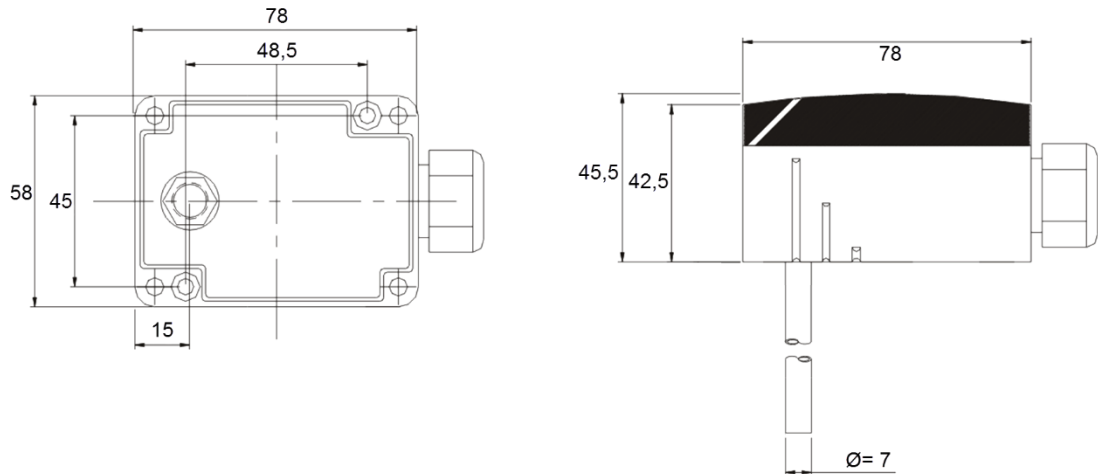

## Optional Accessories

Battery LS14250  
 Mounting flange MF7 flexible (incl. inserts for  $\varnothing=4\text{mm}$  /  $6\text{mm}$ )  
 Mounting flange MF7 (brass)  
 Immersion pocket, mat. brass nickel-plated, safe up to 16 bar  
 Immersion pocket, mat. stainless steel, safe up to 40 bar

Item No. 315098  
 Item No. 399098  
 Item No. 102360  
 THMS  
 THVA