
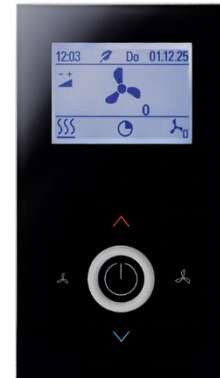


Datasheet

Subject to technical alteration
Issue date: 26.02.2021 • A122

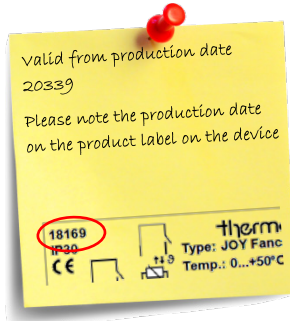

» APPLICATION

JOY Fancoil 5DO RS485 BACnet (85..260 V ~)

Modern design, flush mounting fan coil room thermostat. Used for individual control of temperature in commercial and residential buildings. It is tailored for two-pipe and four-pipe fan coil units with two-wire electric valves. The device combines a modern design with a 2,5" LCD and a touch-sensitive surface, 3 time program options each with 4 time periods options.

JOY Fancoil EC AO2DO RS485 BACnet (85..260 V ~)

Modern fan coil room thermostat to control fan coil units with EC fans. It is suitable for 2- and 4-pipe systems. It has 2 relays and 1 analogue output 0-10V (heating valve, cooling valve and EC fan). The device combines a modern design with a 2,5" LCD and a touch-sensitive surface, 3 time program options each with 4 time periods options.

JOY Fancoil EC 3AO RS485 BACnet (24 V ~/=)

Modern design, flush mounting fan coil room thermostat. Used for individual control of temperature in commercial, industrial and residential buildings. It is tailored for two-pipe and four-pipe fan coil units with two-wire electric valves or controlling a 6-way valve. The device combines a modern design with a 2,5" LCD and a touch-sensitive surface, 3 time program options each with 4 time periods options.

» SECURITY ADVICE – CAUTION



The installation and assembly of electrical equipment should only be performed by authorized personnel.

The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.



CAUTION! Risk of electric shock due to live components within the enclosure, especially devices with mains voltage supply (usually between 90..265 V).

Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

» NOTES ON DISPOSAL



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

» REMARKS TO ROOM SENSORS

Location and Accuracy of Room Sensors

The room sensor should be mounted in a suitable location for measuring accurate room temperature. The accuracy of the temperature measurement also depends directly on the temperature dynamics of the wall. It is important, that the back plate is completely flush to the wall so that the circulation of air occurs through the vents in the cover. Otherwise, deviations in temperature measurement will occur due to uncontrolled air circulation. Also the temperature sensor should not be covered by furniture or similar devices. Mounting next to doors (due to draught) or windows (due to colder outside wall) should be avoided.

The temperature dynamics of the wall will influence the temperature measurement. Various wall types (brick, concrete, dividing and hollow brickwork) all have different behaviours with regards to thermal variations.

Surface and Flush Mounting

The temperature dynamics of the wall influence the measurement result of the sensor. Various wall types (brick, concrete, dividing and hollow brickwork) have different behaviours with regard to thermal variations. A solid concrete wall responds to thermal fluctuations within a room in a much slower way than a light-weight structure wall. Room temperature sensors installed in flush boxes have a longer response time to thermal variations. In extreme cases they detect the radiant heat of the wall even if the air temperature in the room is lower for example. The quicker the dynamics of the wall (temperature acceptance of the wall) or the longer the selected inquiry interval of the temperature sensor is the smaller the deviations limited in time are.

» PRODUCT TESTING AND CERTIFICATION



Declaration of conformity

The declaration of conformity of the products can be found on our website <https://www.thermokon.de/>.

» DIAGNOSTICS MENU

To access the diagnostics menu, select the header in the startscreen of the parameter menu, and press the ENTER key. Here you will find various information, such as device type, software version, state of the inputs and outputs and controller state (current manipulated variable).

» MOUNTING ADVICES

Plasterboard boxes shall be covered by wall paper or paint to avoid that the plasterboard box's front rim will be partially visible underneath JOY. Maybe consider using white plasterboard boxes (i.e. Kaiser 9063-77).

» APPLICATION NOTICE

Boot Loader

A bootloader integrated in the device, makes it possible to install a new application (update, upgrade) using a MicroSD card. To insert the SD card, the upper part must be removed. If the boot loader is activated, the ring illumination blinks in a 1s cycle, while display is not triggered! After recognition of a MicroSD card with a valid application the update process is started. Now, ring illumination blinks fast in a 300ms cycle. After a successful update process (Duration approx. 20-30 seconds!), the new application is started automatically. Afterwards, SD card have to be removed!

MicroSD-Card

MicroSD cards can be used to upload a new application or a new device configuration. Only MicroSD cards formatted in the FAT file system can be used! NTFS and exFAT file systems are not supported.

Software

A detailed description of the parameter and the configuration software can be downloaded from our website.

The parameters for the display, set point and the controller can only be changed via the configuration software.

» CONFIGURATION VIA UCONFIG | MICROSD-CARD OR BACNET



Configuration software:

uConfig | Windows 10 is required to use the uConfig configuration software

The JOY room thermostat can be parameterised using the uConfig configuration software. An SD card is used to transfer the created configuration file to the device. For BUS devices, a live configuration can also be performed via the BUS interface.

The online installer for the configuration software can be found in our download center. The installer retrieves all necessary files and plug-ins from our web server. In this version an update function is integrated in the software.

→ [Download Online-Installer](#)

A separate offline installer is available for installations on PCs/Notebooks without internet connection. For an update of the software a recurring reinstallation is necessary.

→ [Download Offline-Installer](#)

» CONNECTION PLAN

JOY FANCOIL 5DO (85..260 V ~)	JOY FANCOIL EC AO2DO (85..260 V ~)	JOY FANCOIL EC 3AO (24 V ~/≐)																							
<table border="1"> <tr><td>1 Fan Speed 3</td></tr> <tr><td>2 Fan Speed 2</td></tr> <tr><td>3 Fan Speed 1</td></tr> <tr><td>4 Cooling</td></tr> <tr><td>5 Heating</td></tr> <tr><td>6 Digitaler Input 2 (230 V)</td></tr> <tr><td>7 L</td></tr> <tr><td>8 N</td></tr> </table>	1 Fan Speed 3	2 Fan Speed 2	3 Fan Speed 1	4 Cooling	5 Heating	6 Digitaler Input 2 (230 V)	7 L	8 N	<table border="1"> <tr><td>1 EC Fan GND</td></tr> <tr><td>2 EC Fan (0..10 V)</td></tr> <tr><td>4 Cooling</td></tr> <tr><td>5 Heating</td></tr> <tr><td>6 Digital Input 2 (230V)</td></tr> <tr><td>7 L</td></tr> <tr><td>8 N</td></tr> </table>	1 EC Fan GND	2 EC Fan (0..10 V)	4 Cooling	5 Heating	6 Digital Input 2 (230V)	7 L	8 N	<table border="1"> <tr><td>1 Digital Input 2</td></tr> <tr><td>2 EC Fan (0..10 V)</td></tr> <tr><td>3 Cooling (0..10 V) or 6-way valve</td></tr> <tr><td>4 Heating (0..10 V) or 6-way valve</td></tr> <tr><td>5 GND DI 2</td></tr> <tr><td>6 GND</td></tr> <tr><td>7 24 V = (±10%) or 24 V ~ (±10%)</td></tr> <tr><td>8 GND</td></tr> </table>	1 Digital Input 2	2 EC Fan (0..10 V)	3 Cooling (0..10 V) or 6-way valve	4 Heating (0..10 V) or 6-way valve	5 GND DI 2	6 GND	7 24 V = (±10%) or 24 V ~ (±10%)	8 GND
1 Fan Speed 3																									
2 Fan Speed 2																									
3 Fan Speed 1																									
4 Cooling																									
5 Heating																									
6 Digitaler Input 2 (230 V)																									
7 L																									
8 N																									
1 EC Fan GND																									
2 EC Fan (0..10 V)																									
4 Cooling																									
5 Heating																									
6 Digital Input 2 (230V)																									
7 L																									
8 N																									
1 Digital Input 2																									
2 EC Fan (0..10 V)																									
3 Cooling (0..10 V) or 6-way valve																									
4 Heating (0..10 V) or 6-way valve																									
5 GND DI 2																									
6 GND																									
7 24 V = (±10%) or 24 V ~ (±10%)																									
8 GND																									
<table border="1"> <tr><td>12 B</td></tr> <tr><td>11 A</td></tr> <tr><td>10 GND DI 1</td></tr> <tr><td>9 Digital Input 1 (or NTC10K)</td></tr> </table>	12 B	11 A	10 GND DI 1	9 Digital Input 1 (or NTC10K)	<table border="1"> <tr><td>12 B</td></tr> <tr><td>11 A</td></tr> <tr><td>10 GND DI 1</td></tr> <tr><td>9 Digital Input 1 (or NTC10K)</td></tr> </table>	12 B	11 A	10 GND DI 1	9 Digital Input 1 (or NTC10K)	<table border="1"> <tr><td>12 B</td></tr> <tr><td>11 A</td></tr> <tr><td>10 GND DI 1</td></tr> <tr><td>9 Digital Input 1 (or NTC10K)</td></tr> </table>	12 B	11 A	10 GND DI 1	9 Digital Input 1 (or NTC10K)											
12 B																									
11 A																									
10 GND DI 1																									
9 Digital Input 1 (or NTC10K)																									
12 B																									
11 A																									
10 GND DI 1																									
9 Digital Input 1 (or NTC10K)																									
12 B																									
11 A																									
10 GND DI 1																									
9 Digital Input 1 (or NTC10K)																									

Note: Parallel connection of the potential-loaded inputs is not permitted!

If the operating mode (change-over DI) of several devices is to be switched together by one contact, the potential-free 230V input must be used (DI2, only possible with the 230V version). It must be ensured that the same phase is used for jointly switched devices.

» TECHNICAL DATA

JOY Fancoil 5DO | JOY Fancoil EC AO2DO | JOY Fancoil EC 3AO

Measuring values	temperature, humidity (optional)	
Network technology	RS485 BACnet	
Measuring range temp.	0..+50 °C	
Accuracy temperature	±1 K (typ. bei 21 °C)	
Measuring range humidity (optional)	0..100% rH non-condensing	
Accuracy humidity (optional)	±2% between 10..90% rH (typ. at 21 °C)	
Control function	setpoint adjustment +0..+50 °C, fan stages	
Display	LCD 2,5", 240x160 px, white backlighting	
Functions	integrated PI- and 2-point-/ 3-point-controllers, 2nd control loop: 2-point controller	
Enclosure	PC and glass, optional black or white	
Protection	IP30 according to EN 60529	
Connection electrical	Terminal 1..8 terminal block max. 1,5 mm ²	Terminal 9..12 terminal block max. 1.0 mm ²
Ambient condition	0..+50 °C, max. 85% rH non-condensing	
Weight	195 g	
Mounting	flush mounted with standard EU box (Ø=60 mm)	

JOY FANCOIL 5DO

Output switch contact	3x normally open contacts (fan speed), 240 V, load max. 3 A	2x normally open contacts (heating/cooling), 240 V, load max. 500 mA
Power supply	85..260 V ~	
Power consumption	max. 2,5 VA (260 V ~)	
Inputs	DI1 input for NTC 10 K or floating contact	DI2 digital input for non-floating contact (230 V ~)

JOY FANCOIL EC AO2DO

Output voltage	1x 0..10 V, max. load 5 mA, EC FAN control	
Output switch contact	2x normally open contacts (heating/cooling), 240 V max. load 500 mA	
Power supply	85..260 V ~	
Power consumption	max. 3 VA (260 V ~)	
Inputs	DI1 input for NTC 10 K or floating contact	DI2 digital input for non-floating contact (230 V ~)

JOY FANCOIL 3AO

Ausgang Spannung	3x 0..10 V, max. Last 5 mA, Ansteuerung EC Lüfter, Heizen & Kühlen oder Ansteuerung 6-Wege-Ventil (konfigurierbar via Software)	
Spannungsversorgung	24 V = (±10%) oder 24 V ~ (±10%) SELV	
Leistungsaufnahme	max. 2,5 W (24 V =)	
Eingänge	DI 1 1 Eingang für NTC10k oder potentialfreien Kontakt	DI 2 Eingang digital, für potentialfreien Kontakt

***Power supply**

When several BUS devices are supplied by one 24 V AC voltage supply, it is to be ensured that all "positive" operating voltage input terminals (+) of the field devices are connected with each other and all "negative" operating voltage input terminals (-) (=reference potential) are connected together (in-phase connection of field devices).

In case of reversed polarity at one field device, a supply voltage short-circuit would be caused by that device. The consequential short-circuit current flowing through this field may cause damage to it.

Therefore, pay attention to correct wiring.

» FUNCTION DESCRIPTION – CONTROLLER/FAN STAGES

JOY FANCOIL 5DO (85..260 V ~)	JOY FANCOIL EC AO2DO (85..260 V ~)	JOY FANCOIL EC 3AO (24 V ~/=)
PI controller (PWM) & 2-point/3-point controller (configurable)	PI controller (PWM) & 2-point/3-point controller (configurable)	PI controller (0..10 V)

Fan stages (all types)

In automatic mode the fan speed is linked to the controller. The assignment of the fan stage to the control (heating / cooling, only heating, only cooling) is freely selectable. To ensure that the fan motor starts reliably, a period of time can be configured in which the fan starts with maximal value. Using one or more time channels, the fan control have to be set per timechannel and per period. Via the touch surface the user has the option to override the settings of the device every time. When the next time channel starts, the fan speed is set to the configured value. The fan is set to automatic mode when the user changes the occupancy state (occupied↔unoccupied).

Heating/ cooling with PI-controller (PWM) (only 5DO and EC AO2DO)

The time response of the PI control loop depends on the control parameters x_p for the proportional area and t_n for the reset time of the integral range. In case of an error, the P portion immediately changes the position value proportionally to the error variable, while the integral portion takes effect after a certain time.

The resulting actuating variable is output as a pulse-width-modulated signal directly to the outputs.

Heating/ cooling with 2-point-/ 3-point-controller (only 5DO and EC AO2DO)

In the case of temperature control, the 2-point controller only knows the switching states heating ON and heating OFF. The 3-point controller also knows the switching state of cooling. Two - and three-point controller work with a hysteresis.

Heating/ cooling with PI-controller (0..10 V) (only EC 3AO)

The time response of the PI control loop depends on the control parameters x_p for the proportional area and t_n for the reset time of the integral range. In case of an error variable, the P portion immediately changes the position value proportionally to the error variable, while the integral portion takes effect after a certain time.

The resulting manipulated variable is output as an analogue 0..10 V signal directly to the outputs.

EC Fan automatic mode with PI-controller (only EC 3AO and EC AO2DO)

(for EC AO2DO with two-point/three-point controller, the temperature range for controlling the 0..10 V EC fan is parameterised separately)

The 0..10 V (0..100%) control of the fan is proportional to the calculated manipulated variable of the PI controller.

Example:

Calculated actuating variable 65% → Fan control with 6,5 V.

Calculated actuating variable 22% → Fan control with 2,2 V.

EC Fan manual with PI-controller (only EC 3AO and EC AO2DO)

Up to 5 steps (steps) can be set using the configuration software. The set number of steps is divided linearly to the manipulated variable of 0..100%.

Example:

Max. steps (stages) = 5

Stage 1 = 20%

Stage 2 = 40%

Stage 3 = 60%

Stage 4 = 80%

Stage 5 = 100%

Max. steps (stages) = 3


Stage 1 = 33%

Stage 2 = 66%

Stage 3 = 100%

» **FUNCTION DESCRIPTION - BUTTONS**


On the touch surface, there are adjustment options for setpoint and fan speed regulation.

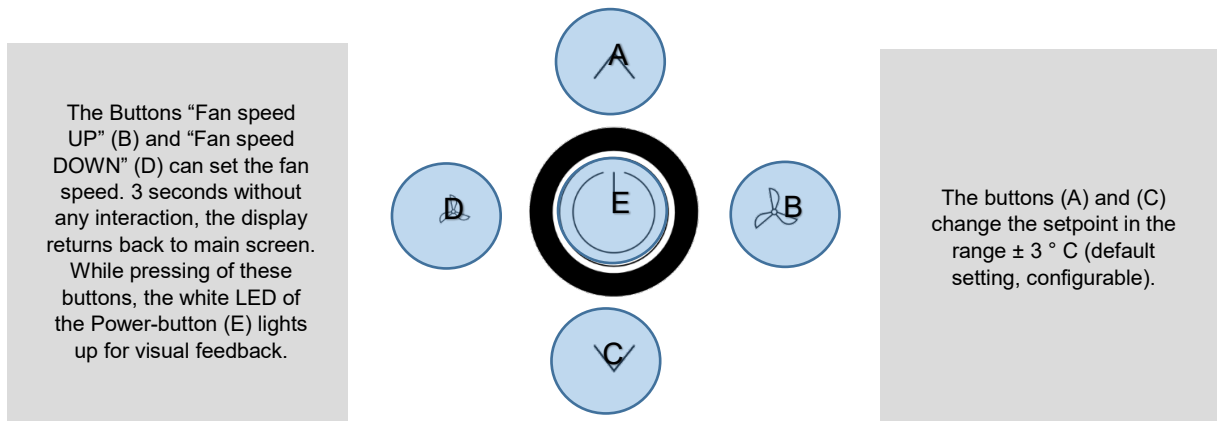

The Power button (E) can be used to switch the room thermostat to standby mode (not possible if the Keycard switch function is used!) If the key is used as a presence key at the same time, the key must be pressed for at least 3s, in all other cases a short press is sufficient. In standby mode the display and all outputs are switched off (controller deactivated). The frost and heat protection monitoring remains active. **BACnet objects can still be read (e.g. room temperature).**

Main screen/ Value display

The Display shows the measured value of the internal sensor. The value of an external sensor will be shown if connected and configured accordingly. The room thermostat controls in this case according to the external sensor. With an optional humidity sensor, the relative room humidity can also be displayed on the main screen. The display is not active by default and must be activated.

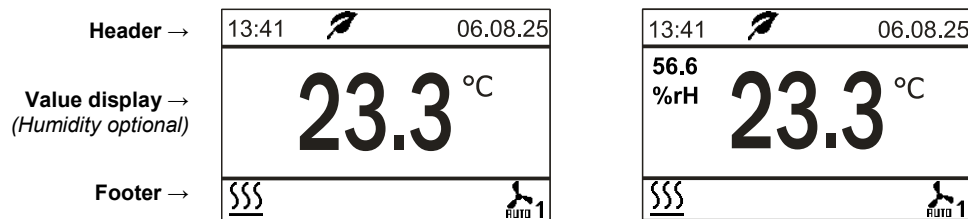

Header

In the header line, the time, weekday and date are displayed. In addition, the ECO info symbol (sheet) is displayed here when the ECO mode is switched on. It is possible to show an alarm symbol (exclamation mark) in the display. This symbol is located at the same position as the ECO symbol. Since the alarm symbol has a higher priority, it overwrites the ECO symbol.


Footer - Symbols

Depending upon the heating or cooling mode, occupancy or window contact status, the corresponding symbols will be shown in the footer. The symbol "active timechannel" will be shown only if active.

Occupancy		
Window contact/dewpoint		
Heating/Cooling		
Fan Speed		
Active timechannel		

» CONFIGURATION VIA THE DISPLAY MENU

Buttons

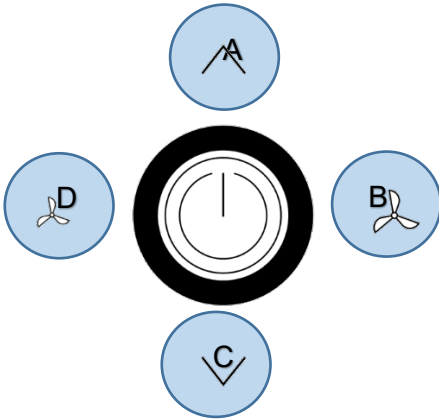

The configuration menu is activated by simultaneously pressing the buttons "up" (A), "left" (D) and "right" (B) for at least 3 seconds. Menu navigation on the touch-surface is performed by pressing the buttons "up" (A), "down" (C), "left" (D), "right" (B) or the power button. Choose the desired parameter and press "right" (B) to open up the submenu. If no entry is made for 8 minutes, the parameter menu is left automatically. To exit the menu select the header line and press "left" (D)

Menu
Timechannels
Time/Date
Sensor settings
Common settings

» MENU → TIME CHANNELS

In the Time Channels menu, setpoint and timer can be set. Up to 3 time channels with 4 time periods each can be parameterized. The time channels are prioritised. Channel 3 has the highest priority. After selecting the line of the time channel to be edited, the next submenu is called up with the "Right" key. It is possible to set any time period within one week in the first two lines with the "Left" (-) / "Right" (+) keys. In addition, the ECO mode is available in the menu sections. In ECO mode, the dead zone between heating and cooling is automatically set to the ECO dead zone configured in the "General Settings" menu (default: 10 K).

Timechannels
Timechannel 1 Mo - Fr
Timechannel 2
Timechannel 3

Timechannels/Timer1
from day <-/+> Mo
to day <-/+> Fr
1: 06:00h - A - 22.0° ✓▷
2: 08:30h - 1 - 20.0° ✓▷
3: 16:00h - A - 22.0° ✓▷
4: 22:30h - 0 - 22.0°ECO ✓▷

Periods/Period1
Start <-/+> 06:00h
Fan <-/+> AUTO
Temp <-/+> 22.0°
ECO-Mode ✓

» MENU → TIME/DATE

Time, Date and display format can be configured in the menu settings. The room thermostat is equipped with a real-time clock so that it automatically adjusts for daylight-saving time. This function can be disabled in the datetime settings.

Menu
Timechannels
Time/Date
Sensor settings
Common settings

Datetime setting/Time
Hour <-/+> 13
Minute <-/+> 07
12h/24h <-/+> 24h
Daylight saving <-/+> CET
Date ▷

Datetime setting/Date
Day <-/+> 12
Month <-/+> 08
Year <-/+> 15
Presentation <-/+> T.M.J

» MENU → SENSOR SETTINGS

Offset correction for internal and external sensor value. The temperature display can also be changed from °C to °F.

Menu	Sensor settings
Timechannels ▾	Offset int. ◀-/▶ 0.6 K
Time/Date ▾	Value int. 22.1°C
Sensor settings ▶	Offset ext. ◀-/▶ 0.2 K
Common settings ▾	Value ext. 22.1°C
	Unit ◀-/▶ Celsius

» MENU → COMMON SETTINGS

The common settings includes the brightness of the background lighting and the LED. Valve protection prevents the valves becoming ceased when they are switched off for long periods. If the valve protection function is activated, a valve-check is carried out every Friday at 11:00 am for the heating valve and 11:15 am for the cooling valve. The corresponding valve is triggered for 5 minutes, if not activated during the last 96 hours. The dead band can be adjusted (default 10.0 K, see timechannels). The room thermostat has 3 outputs for fan control with up to 3 fan stages. The amount of fan stages are configurable.

Menu	Settings/Common	Settings/Common	Settings/Language
Timechannels ▾	Brightness LCD ◀-/▶ 100%	Valve protect ◀-/▶ ON	Deutsch ✓
Time/Date ▾	Brightness LED ◀-/▶ 100%	ECO deadband ◀-/▶ 10.0K	English
Sensor settings ▾		Fanstages ◀-/▶ 3	
Common settings ▶	Common ▶	Language ▾	Factory setting ▶


Factory settings

By selecting "Factory setting", the room thermostat will be reset and restore the device to factory default settings.

» PARAMETER MENU – BACNET INTERFACE

The configuration menu is activated by simultaneously pressing the buttons "up" (A) and "down" (C) for at least 5 seconds.

The menu is enabled during the first 60 minutes after switching on the supply voltage as long as the device is not actively involved in BACnet communication. As soon as the device receives a valid request addressed to the device from a DDC, access to the menu is blocked. Without valid communication, access is blocked after 60 minutes!

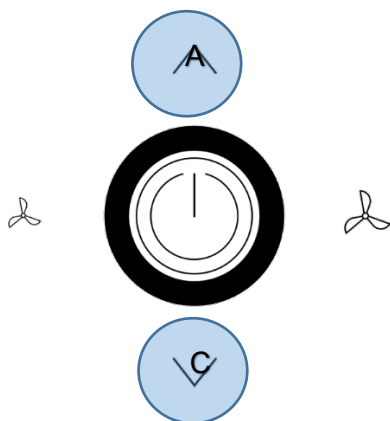

BACnet settings	
Address ◀-/▶	32
Baudrate ◀-/▶	38400

Address (default: 32)
Adjustable address (1-247)

Baud rate (default: 19200)
9600Bd | 19200Bd | 38400Bd | 57600 | 76800 | 115200 Bd

» INPUTS

Up to 2 inputs are configurable for functions such as windows contact, dew point, occupancy, change-over or external sensor option.
The overview of possible combinations can be found in the software specification of the JOY.

Sensor (NTC10K)

The value of an external sensor will be shown if connected and configured accordingly. In this case, the room thermostat controls according to the external sensor. Alternatively, an external temperature sensor can be used at the universal input to protect floor heating. If a configured temperature is exceeded, the heating sequence is suspended.

Change-Over DI

Which controller is active depends on the state of the Change-Over contact. (Factory default: contact open heating controller active, contact closed cooling controller active). The terminals 4 and 5 are used as outputs for heating resp. cooling.

Change-Over Sensor

The Change-Over Sensor is used for switching between heating and cooling mode automatically. If the temperature is below 22 ° C, the controller is in cooling mode. If it is above 25 ° C, it is a heating mode.

If an input is configured as a change-over, the room thermostat is automatically in 2-pipe operating mode and both outputs (terminals 4 and 5) are used as outputs for heating resp. cooling.

Window contact/Energy hold off

If a window contact is enabled via the digital input, the reference will switch to a setback set point (Heat SP/Cool SP).

Dewpoint

An active dewpoint contact locks the cooling controller.

Occupancy

If occupancy-function is active, the symbol will be displayed automatically. In state of "unoccupied" the heating set point is reduced by 2K (default setting) resp. the cooling set point raised by 2K.


Keycard-Switch

When the card is not inserted, the device is switched in sleep mode. Operation of the keys is locked, the display is switched off and the controller adjusts to the nominal values of the "unoccupied"-State.

Alarm contact

An alarm symbol can be shown in the header of the display. The backlight flashes when the alarm is active. This symbol is in the same position as the ECO symbol. The alarm symbol has a higher priority and overwrites the ECO symbol!

» DIMENSIONS (MM)

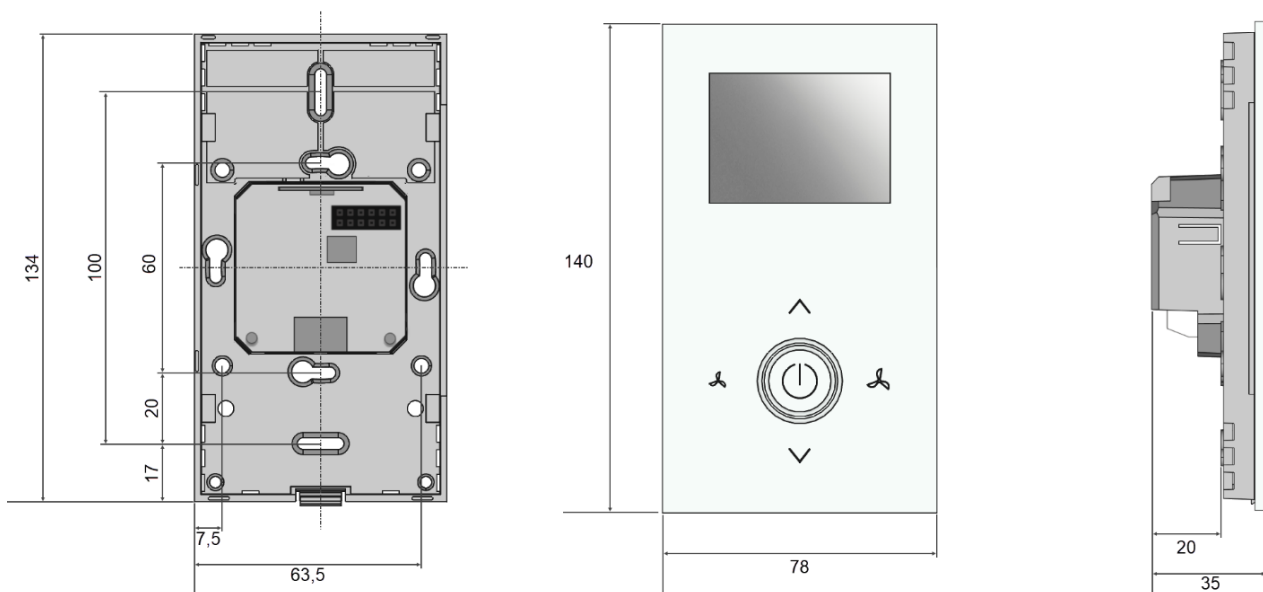

» ACCESSORIES (OPTIONAL)

Decorative frame pure white for JOY
 Decorative frame black for JOY
 MicroSD card 2GB

Item No. 681452
 Item No. 740951
 Item No. 500098