


» JOY HC AO2DO | HC 3AO

Room Regulator
(from Version 2.6.x)

thermokon[®]
HOME OF SENSOR TECHNOLOGY

Datasheet

Subject to technical alteration
Issue date: 26.02.2021 • A122

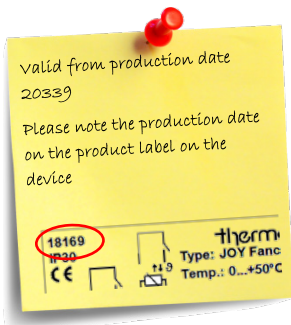

» APPLICATION

JOY HC AO2DO (85..260 V ~)

Room thermostat in an appealing design for heating/cooling (230 V) and controlling a 6-way valve. Used for individual control of temperature in commercial and residential buildings. The device combines a modern design with a 2,5" touch surface, which enables the single room controller to be used intuitively. 3 time channels with 4 periods of time can be configured via the menu. This device is suitable for a flush mount box.

JOY HC 3AO (24 V ~/=)

Modern design, flush mounting room thermostat. Used for individual control of temperature in commercial, industrial and residential buildings. It is tailored for two-pipe and four-pipe units with two-wire electric valves and controlling a 6-way valve. The device combines a modern design with a 2,5" LCD and a touch-sensitive surface, 3 time program options each with 4 time periods options.

» SECURITY ADVICE – CAUTION



The installation and assembly of electrical equipment should only be performed by authorized personnel.

The product should only be used for the intended application. Unauthorised modifications are prohibited! The product must not be used in relation with any equipment that in case of a failure may threaten, directly or indirectly, human health or life or result in danger to human beings, animals or assets. Ensure all power is disconnected before installing. Do not connect to live/operating equipment.

CAUTION! Risk of electric shock due to live components within the enclosure, especially devices with mains voltage supply (usually between 90..265 V).



Please comply with

- Local laws, health & safety regulations, technical standards and regulations
- Condition of the device at the time of installation, to ensure safe installation
- This data sheet and installation manual

» NOTES ON DISPOSAL



As a component of a large-scale fixed installation, Thermokon products are intended to be used permanently as part of a building or a structure at a pre-defined and dedicated location, hence the Waste Electrical and Electronic Act (WEEE) is not applicable. However, most of the products may contain valuable materials that should be recycled and not disposed of as domestic waste. Please note the relevant regulations for local disposal.

» REMARKS TO ROOM SENSORS

Location and Accuracy of Room Sensors

The room sensor should be mounted in a suitable location for measuring accurate room temperature. The accuracy of the temperature measurement also depends directly on the temperature dynamics of the wall. It is important, that the back plate is completely flush to the wall so that the circulation of air occurs through the vents in the cover. Otherwise, deviations in temperature measurement will occur due to uncontrolled air circulation. Also the temperature sensor should not be covered by furniture or similar devices. Mounting next to doors (due to draught) or windows (due to colder outside wall) should be avoided.

The temperature dynamics of the wall will influence the temperature measurement. Various wall types (brick, concrete, dividing and hollow brickwork) all have different behaviours with regards to thermal variations.

Surface and Flush Mounting

The temperature dynamics of the wall influence the measurement result of the sensor. Various wall types (brick, concrete, dividing and hollow brickwork) have different behaviours with regard to thermal variations. A solid concrete wall responds to thermal fluctuations within a room in a much slower way than a light-weight structure wall. Room temperature sensors installed in flush boxes have a longer response time to thermal variations. In extreme cases they detect the radiant heat of the wall even if the air temperature in the room is lower for example. The quicker the dynamics of the wall (temperature acceptance of the wall) or the longer the selected inquiry interval of the temperature sensor is the smaller the deviations limited in time are.

» PRODUCT TESTING AND CERTIFICATION



Declaration of conformity

The declaration of conformity of the products can be found on our website <https://www.thermokon.de/>.

» DIAGNOSTICS MENU

To access the diagnostics menu, select the header in the startscreen of the parameter menu, and press the ENTER key. Here you will find various information, such as device type, software version, state of the inputs and outputs and controller state (current manipulated variable).

» MOUNTING ADVICES

Plasterboard boxes shall be covered by wall paper or paint to avoid that the plasterboard box's front rim will be partially visible underneath JOY. Maybe consider using white plasterboard boxes (i.e. Kaiser 9063-77).

» APPLICATION NOTICE

Boot Loader

A bootloader integrated in the device, makes it possible to install a new application (update, upgrade) using a MicroSD card. To insert the SD card, the upper part must be removed. If the boot loader is activated, the ring illumination blinks in a 1s cycle, while display is not triggered! After recognition of a MicroSD card with a valid application the update process is started. Now, ring illumination blinks fast in a 300ms cycle. After a successful update process (Duration approx. 20-30 seconds!), the new application is started automatically. Afterwards, SD card have to be removed!

MicroSD-Card

MicroSD cards can be used to upload a new application or a new device configuration. Only MicroSD cards formatted in the FAT file system can be used! NTFS and exFAT file systems are not supported.

Software

A detailed description of the parameter and the configuration software can be downloaded from our website.

The parameters for the display, set point and the controller can only be changed via the configuration software.

» CONFIGURATION VIA UCONFIG | MICROSD-CARD



Configuration software:

uConfig | Windows 10 is required to use the uConfig configuration software

The JOY room thermostat can be parameterised using the uConfig configuration software. An SD card is used to transfer the created configuration file to the device. For BUS devices, a live configuration can also be performed via the BUS interface.

The online installer for the configuration software can be found in our download center. The installer retrieves all necessary files and plug-ins from our web server. In this version an update function is integrated in the software.

→ [Download Online-Installer](#)

A separate offline installer is available for installations on PCs/Notebooks without internet connection. For an update of the software a recurring reinstallation is necessary.

→ [Download Offline-Installer](#)

» CONNECTION PLAN

| JOY HC AO2DO (85..260 V ~) | JOY HC 3AO (24 V ~/=) | | | | | | | | | | | | | | | | | | | | | | | | |
|---|-----------------------|-------------------------|---|-----------|-----------|--------------------------|-----|-----|-------------------------------|-------------|--------------------|-------------|--|-------------------|-------------------------|---------------------|---------------------|-----------|-------|----------------------------------|-------|-------------------------------|-------------|---------------------|-------------|
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | |
| <table border="1"> <tr><td>1 GND (6-way valve)</td></tr> <tr><td>2 0..10 V (6-way valve)</td></tr> <tr><td>3</td></tr> <tr><td>4 Cooling</td></tr> <tr><td>5 Heating</td></tr> <tr><td>6 Digital Input 2 (230V)</td></tr> <tr><td>7 L</td></tr> <tr><td>8 N</td></tr> <tr><td>9 Digital Input 1 (or NTC10K)</td></tr> <tr><td>10 GND DI 1</td></tr> <tr><td>11 Digital Input 3</td></tr> <tr><td>12 GND DI 3</td></tr> </table> | 1 GND (6-way valve) | 2 0..10 V (6-way valve) | 3 | 4 Cooling | 5 Heating | 6 Digital Input 2 (230V) | 7 L | 8 N | 9 Digital Input 1 (or NTC10K) | 10 GND DI 1 | 11 Digital Input 3 | 12 GND DI 3 | <table border="1"> <tr><td>1 Digital Input 2</td></tr> <tr><td>2 6-way valve (0..10 V)</td></tr> <tr><td>3 Cooling (0..10 V)</td></tr> <tr><td>4 Heating (0..10 V)</td></tr> <tr><td>5 GND DI2</td></tr> <tr><td>6 GND</td></tr> <tr><td>7 24 V = (±10%) or 24 V ~ (±10%)</td></tr> <tr><td>8 GND</td></tr> <tr><td>9 Digital Input 1 (or NTC10K)</td></tr> <tr><td>10 GND DI 1</td></tr> <tr><td>11 Digital Input 33</td></tr> <tr><td>12 GND DI 3</td></tr> </table> | 1 Digital Input 2 | 2 6-way valve (0..10 V) | 3 Cooling (0..10 V) | 4 Heating (0..10 V) | 5 GND DI2 | 6 GND | 7 24 V = (±10%) or 24 V ~ (±10%) | 8 GND | 9 Digital Input 1 (or NTC10K) | 10 GND DI 1 | 11 Digital Input 33 | 12 GND DI 3 |
| 1 GND (6-way valve) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 0..10 V (6-way valve) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 Cooling | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 Heating | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 Digital Input 2 (230V) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 L | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 N | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 Digital Input 1 (or NTC10K) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 GND DI 1 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 Digital Input 3 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 GND DI 3 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 1 Digital Input 2 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 2 6-way valve (0..10 V) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 Cooling (0..10 V) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 4 Heating (0..10 V) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 5 GND DI2 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 6 GND | | | | | | | | | | | | | | | | | | | | | | | | | |
| 7 24 V = (±10%) or 24 V ~ (±10%) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 8 GND | | | | | | | | | | | | | | | | | | | | | | | | | |
| 9 Digital Input 1 (or NTC10K) | | | | | | | | | | | | | | | | | | | | | | | | | |
| 10 GND DI 1 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 11 Digital Input 33 | | | | | | | | | | | | | | | | | | | | | | | | | |
| 12 GND DI 3 | | | | | | | | | | | | | | | | | | | | | | | | | |

Note: Parallel connection of the potential-loaded inputs is not permitted!

If the operating mode (change-over DI) of several devices is to be switched together by one contact, the potential-free 230V input must be used (DI2, only possible with the 230V version). It must be ensured that the same phase is used for jointly switched devices.

» **TECHNICAL DATA****JOY HC AO2DO | HC 3AO**

| | | |
|-------------------------------------|--|--|
| Measuring values | temperature, humidity (optional) | |
| Measuring range temp | 0..+50 °C | |
| Accuracy temperature | ±1 K (typ. at 21 °C) | |
| Measuring range humidity (optional) | 0..100% rH non-condensing | |
| Accuracy humidity (optional) | ±2% between 10..90% rH (typ. at 21 °C) | |
| Control functions | setpoint adjustment +0..+50 °C | |
| Display | LCD 60x44 mm, 240x160 px, white backlighting | |
| Functions | integrated PI- and 2-point-/ 3-point-controllers, 2nd control loop: 2-point controller | |
| Enclosure | PC, glass, optional black or white | |
| Protection | IP30 according to EN 60529 | |
| Connection electrical | Terminal 1..8 terminal block max. 1,5 mm ² | Terminal 9..12 terminal block max. 1.0 mm ² |
| Ambient condition | 0..+50 °C, max. 85% rH non-condensing | |
| Weight | 195 g | |
| Mounting | flush mounted with standard EU box (Ø=60 mm) | |

JOY HC AO2DO

| | | | |
|-----------------------|---|--|--|
| Output voltage | 0..10 V =, max. load 5 mA (for 6-way valves) | | |
| Output switch contact | 2x normally open contacts (heating/cooling), 240 V max. load 500 mA | | |
| Power supply | 85..260 V ~ | | |
| Power consumption | max. 3 VA (260 V ~) | | |
| Inputs | DI1 input for NTC 10 K or floating contact | DI2 digital input for non-floating contact (230 V ~) | DI3 digital input for floating contact |

JOY HC 3AO

| | | |
|-------------------|---|---|
| Output voltage | 3x 0..10 V, max. load 5 mA, 6-way valve control, heating & cooling) | |
| Power supply | 24 V = (±10%) or 24 V ~ (±10%) SELV | |
| Power consumption | max. 2,5 W (24 V =) | |
| Inputs | DI 1 1 input for NTC10K or floating contact | DI 2 DI 3 2 inputs for floating contact |

» **FUNCTION DESCRIPTION – CONTROLLER**


| JOY HC AO2DO (85..260 V ~) | JOY HC 3AO (24 V ~/≠) |
|---|-------------------------|
| PI controller (PWM) & 2-point/3-point controller (configurable) | PI controller (0..10 V) |

6WV (PI-controller 0..10 V) (all types)

The manipulated variable is output as a proportional control signal at the output for the 6-way valve. The type of valve used is set via the configuration software. You can choose from 2..10 V / 2..10 V INV (Belimo), 0..10 V DN15 / DN15 INV, DN20 / DN20 INV (Sauter). There is also the possibility of a freely parameterizable 6-way valve (generic 6WV).

Heating/ cooling with 2-point-/ 3-point-controller (only HC AO2DO)

In the case of temperature control, the 2-point controller only knows the switching states heating ON and heating OFF. The 3-point controller also knows the switching state of cooling. Two - and three-point controller work with a hysteresis.

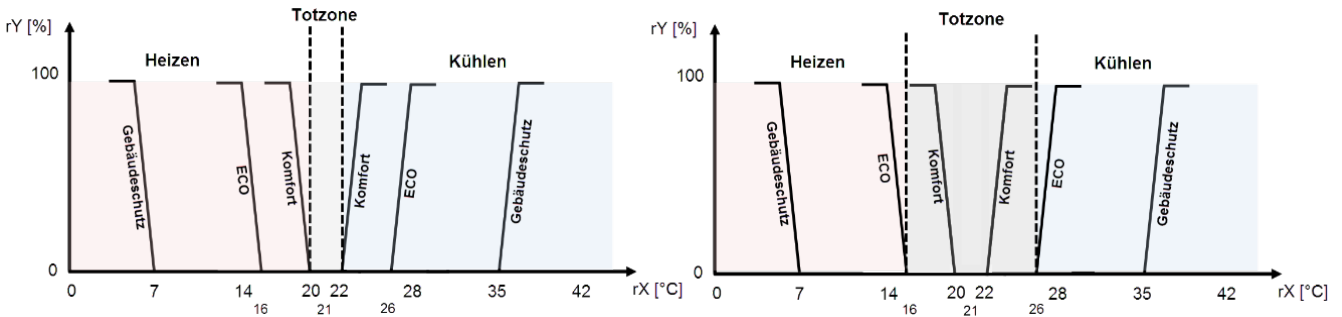

Heating/ cooling with PI-controller (PWM) (only HC AO2DO)

The time response of the PI control loop depends on the control parameters x_p for the proportional area and t_n for the reset time of the integral range. In case of an error, the P portion immediately changes the position value proportionally to the error variable, while the integral portion takes effect after a certain time.

The resulting actuating variable is output as a pulse-width-modulated signal directly to the outputs.


Heating/ cooling with PI-controller (0..10 V) (only HC 3AO)

The time response of the PI control loop depends on the control parameters x_p for the proportional area and t_n for the reset time of the integral range. In case of an error variable, the P portion immediately changes the position value proportionally to the error variable, while the integral portion takes effect after a certain time.

The resulting manipulated variable is output as an analogue 0..10 V signal directly to the outputs.

» FUNCTION DESCRIPTION - BUTTONS



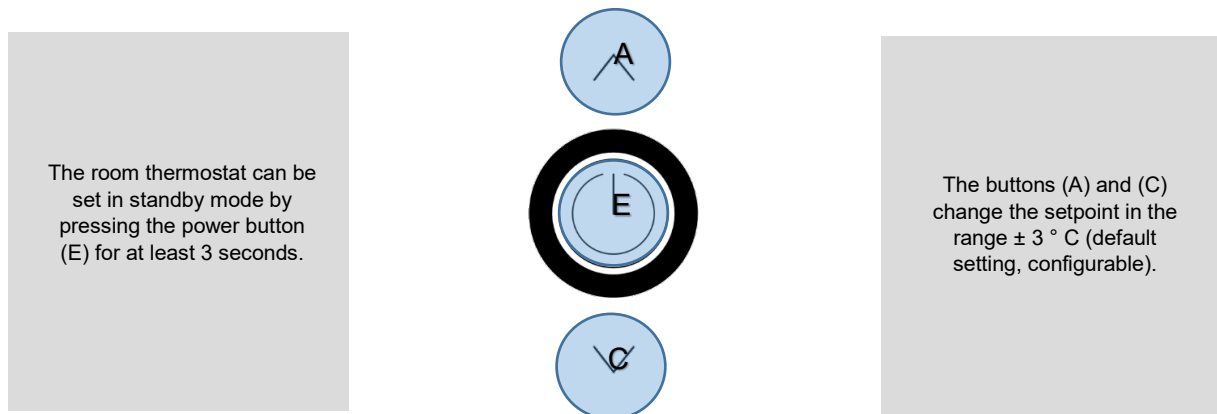



On the touch-surface are the keys for setpoint adjustment. While pressing of these buttons, the white LED of the Power-button lights up for visual feedback.



With power-button (E), the device can be set in standby mode by pressing the button (if keycard-switch function is NOT used). If the button is used as a occupancy button, the button must be pressed for at least 3s, in all other cases, a short actuation is sufficient. In standby mode, the display and all outputs are switched off (controller deactivated). The frost and heat protection monitoring remains active.

Main screen/ Value display

The Display shows the measured value of the internal sensor. The value of an external sensor will be shown if connected and configured accordingly. The room thermostat controls in this case according to the external sensor.









| | | |
|--|---|---|
| Header → | 13:41  06.08.25 | 13:41  06.08.25 |
| Value display → (Humidity optional) | 23.3 °C | 56.6 %rH 23.3 °C |
| Footer → |   |   |

Header

In the header line, the time, weekday and date are displayed. In addition, the ECO info symbol (sheet) is displayed here when the ECO mode is switched on. It is possible to show an alarm symbol (exclamation mark) in the display. This symbol is located at the same position as the ECO symbol. Since the alarm symbol has a higher priority, it overwrites the ECO symbol.


Footer - Symbols

Depending upon the heating or cooling mode, occupancy or window contact status, the corresponding symbols will be shown in the footer. The symbol "active timechannel" will be shown only if active.

| | | |
|-------------------------|---|---|
| Occupancy |  |  |
| Window contact/dewpoint |  |  |
| Heating/Cooling |  |  |
| Active timechannel |  |  |

» **CONFIGURATION**

Buttons

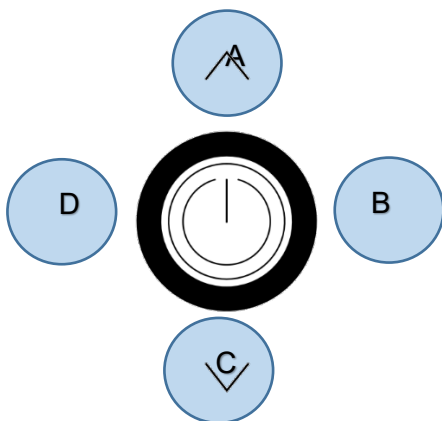

The configuration menu is activated by simultaneously pressing the buttons “up” (A), “left” (D) and “right” (B) for at least 3 seconds.

Menu navigation on the touch-surface is performed by pressing the buttons “up” (A), “down” (C), “left” (D), “right” (B) or the power button. Choose the desired parameter and press “right” (B) to open up the submenu. If no entry is made for 8 minutes, the parameter menu is left automatically. To exit the menu select the header line and press “left” (D)

| | |
|---------------------|---|
| Menu | |
| Timechannels | ▶ |
| Inputs | ▶ |
| Time/Date | ▶ |
| Sensor settings | ▶ |
| Common settings | ▶ |

» **MENU → TIME CHANNELS**

In the Time Channels menu, setpoint and timer can be set. Up to 3 time channels with 4 time periods each can be parameterized. The time channels are prioritised. Channel 3 has the highest priority. After selecting the line of the time channel to be edited, the next submenu is called up with the "Right" key. It is possible to set any time period within one week in the first two lines with the "Left" (-) / "Right" (+) keys. In addition, the ECO mode is available in the menu sections. In ECO mode, the dead zone between heating and cooling is automatically set to the ECO dead zone configured in the "General Settings" menu (default: 10 K).

| | |
|----------------------|-----------|
| Timechannels | |
| Timechannel 1 | Mo - Fr ▶ |
| Timechannel 2 | ▷ |
| Timechannel 3 | ▷ |

| | | |
|---------------------|----------------|----|
| Timechannels/Timer1 | | |
| from day | <-/+> | Mo |
| to day | <-/+> | Fr |
| 1: 06:00h | - A - 22.0° | ✓▶ |
| 2: 08:30h | - 1 - 20.0° | ✓▷ |
| 3: 16:00h | - A - 22.0° | ✓▷ |
| 4: 22:30h | - 0 - 22.0°ECO | ✓▷ |

| | |
|-----------------|--------------|
| Periods/Period1 | |
| Start | <-/+> 06:00h |
| Temp | <-/+> 22.0° |
| ECO-Mode | ✓ |

» MENU → INPUTS

Up to 3 inputs are configurable for functions such as windows contact, dew point, occupancy, change-over or external sensor option.

The overview of possible combinations can be found in the software specification of the JOY.

Sensor (NTC10K)

The value of an external sensor will be shown if connected and configured accordingly. In this case, the room thermostat controls according to the external sensor.

Change-Over DI

Which controller is active depends on the state of the Change-Over contact. (Factory default: contact open heating controller active, contact closed cooling controller active). The terminals 4 and 5 are used as outputs for heating resp. cooling. Alternatively, an external temperature sensor can be used at the universal input to protect floor heating. If a configured temperature is exceeded, the heating sequence is suspended.

Change-Over Sensor

The Change-Over Sensor is used for switching between heating and cooling mode automatically. If the temperature is below 22 ° C, the controller is in cooling mode. If it is above 25 ° C, it is a heating mode.

If an input is configured as a change-over, the room thermostat is automatically in 2-pipe operating mode and both outputs (terminals 4 and 5) are used as outputs for heating resp. cooling.

Window contact/Energy hold off

If a window contact is enabled via the digital input, the reference will switch to a setback set point (Heat SP/Cool SP).

Dewpoint

An active dewpoint contact locks the cooling controller.

Occupancy

If occupancy-function is active, the symbol will be displayed automatically. In state of "unoccupied" the heating set point is reduced by 2K (default setting) resp. the cooling set point raised by 2K.

Keycard-Switch

When the card is not inserted, the device is switched in sleep mode. Operation of the keys is locked, the display is switched off and the controller adjusts to the nominal values of the "unoccupied"-State.

Alarm contact

An alarm symbol can be shown in the header of the display. The backlight flashes when the alarm is active. This symbol is in the same position as the ECO symbol. The alarm symbol has a higher priority and overwrites the ECO symbol!

» MENU → TIME/DATE

Time, Date and display format can be configured in the menu settings. The room thermostat is equipped with a real-time clock so that it automatically adjusts for daylight-saving time. This function can be disabled in the datetime settings.

| Menu | Datetime setting/Time | Datetime setting/Date |
|--------------------|--------------------------|-------------------------|
| Timechannels ▶ | Hour ◀-/▶ 13 | Day ◀-/▶ 12 |
| Inputs ▶ | Minute ◀-/▶ 07 | Month ◀-/▶ 08 |
| Time/Date ▶ | 12h/24h ◀-/▶ 24h | Year ◀-/▶ 15 |
| Sensor settings ▶ | Daylight saving ◀-/▶ CET | Presentation ◀-/▶ T.M.J |
| Common settings ▶ | Date ▶ | |


» MENU → SENSOR SETTINGS

Offset correction for internal and external sensor value. The temperature display can also be changed from °C to °F.

| Sensor settings | | |
|-----------------|------|---------|
| Offset int. | ◀-/▶ | 0.6 K |
| Value int. | | 22.1°C |
| Offset ext. | ◀-/▶ | 0.2 K |
| Value ext. | | 22.1°C |
| Unit | ◀-/▶ | Celsius |

» **MENU → COMMON SETTINGS**


The common settings includes the brightness of the background lighting and the LED. Valve protection prevents the valves becoming ceased when they are switched off for long periods. If the valve protection function is activated, a valve-check is carried out every Friday at 11:00 am for the heating valve and 11:15 am for the cooling valve. The corresponding valve is triggered for 5 minutes, if not activated during the last 96 hours. The dead band can be adjusted (default 10.0 K, see timechannels).

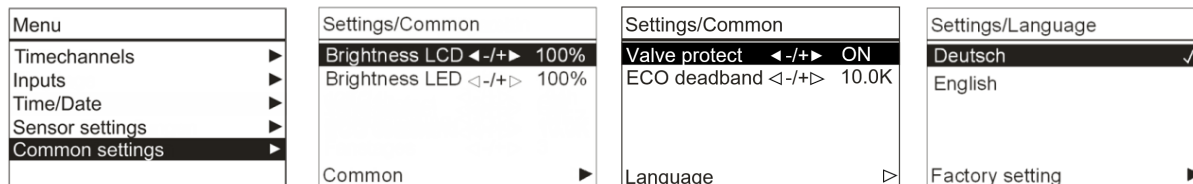

Factory settings

By selecting "Factory setting", the room thermostat will be reset and restore the device to factory default settings.

» **DIMENSIONS (MM)**

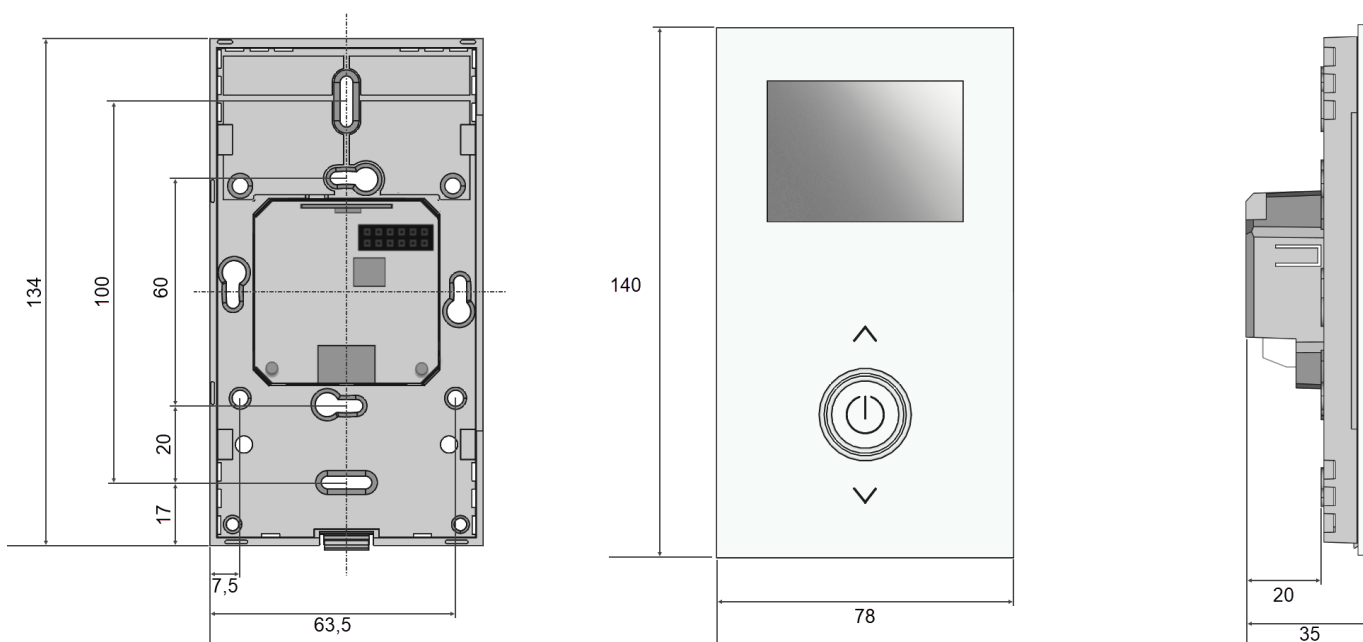

» **ACCESSORIES (OPTIONAL)**

- Decorative frame pure white for JOY
- Decorative frame black for JOY
- MicroSD card 2GB

- Item No. 681452
- Item No. 740951
- Item No. 500098