



|   |   |   |
|---|---|---|
|  TI8100en | <b>Technical Information</b>  |  |
| CRW9-Series (H&T)   | Room Humidity and Temperature Sensor<br>with BACnet or Modbus RTU communication |   |

The CRW9- Series (H&T) is designed to measure temperature, relative humidity,

absolute humidity, enthalpy or dew point in rooms or areas

The sensor operates with low power supply

BACnet MSTP and Modbus RTU on Board

The sensor output is BACnet MSTP / Modbus RTU communication (RS485)



## USE

In Building Automation System where BACnet MSTP or MODBUS RTU communication protocols are used

Compatible to all common HVAC DDC and Analog Controls systems, with Building Automation System

Relative humidity, absolute humidity, enthalpy or dew point and temperature measurement in rooms and areas

Used in all common HVAC applications

Used in Commercial and Industrial Buildings

## Features

BACnet / MODBUS address setting over BUS protocol

High Humidity accuracy

Modern and practical product design








Easy to use, install and maintain

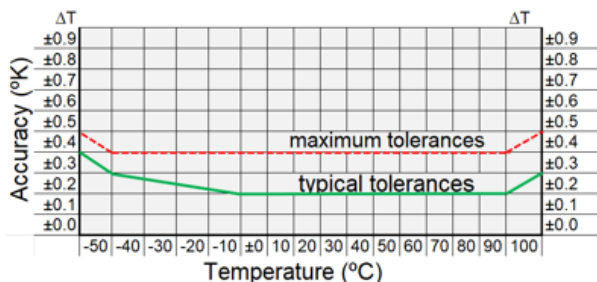
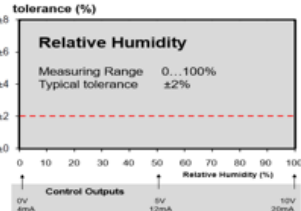
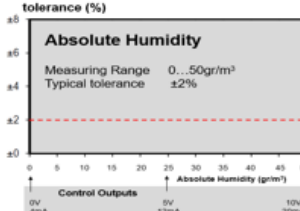
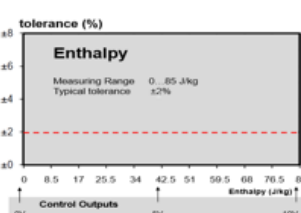
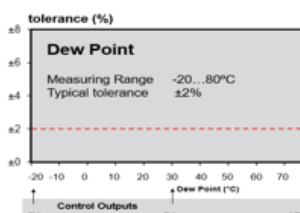
## Product Range

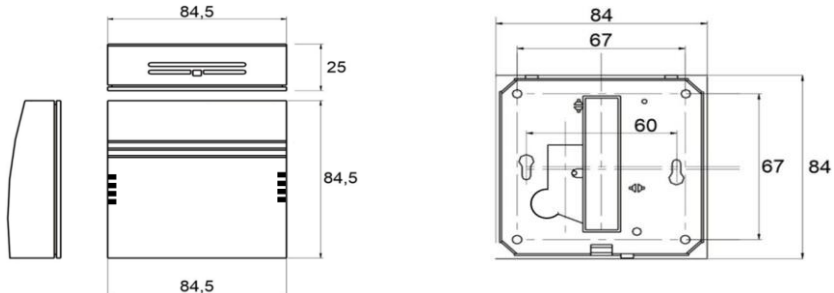
| Order Codes | Power Supply     | Communication system | Humidity Measuring | Measuring Units | IP Rating    |
|-------------|------------------|----------------------|--------------------|-----------------|--------------|
| CRW9.AA     | AC/DC 24V (±10%) | BACnet MSTP (RS485)  | rel. humidity      | 0...100%        | Housing IP20 |
|             |                  |                      | absolute humidity  | 0...50gr/m3     |              |
| CRW9.AG     |                  |                      | Modbus RTU (RS485) | dew point       | -20....80°C  |
|             |                  |                      | enthalpy           | 0...85kJ/Kg     |              |

|                       |                          |  |  |
|-----------------------|--------------------------|--|--|
| Sensor Specification  | Sensor Specification     | Measured   | Temperature & Humidity                                     |
|                       |                          | Outputs  | BACnet MSTP or Modbus RTU communication, RS485             |
|                       |                          | Accuracy   | relative humidity  |
|                       |                          |  | ± 2% over measuring range                                  |
|                       |                          |  | absolute humidity  |
|                       |                          |  | ± 2% over measuring range                                  |
|                       |                          | enthalpy   | ± 2% over measuring range                                  |
|                       |                          |  | ± 2% over measuring range                                  |
|                       |                          | dew point  | ± 2% over measuring range                                  |
|                       |                          | Temperature  | see chart, page 4  |
|                       |                          | IP- Rating sensor element                                | IP67 to IEC60529   |
|                       |                          | Repeatability (H)  | ±0.1°C ; ±0.1% r.h.  |
| Technical Information | Electrical Information   | Power Supply   | AC/DC 24V (±10%)   |
|                       |                          | Frequency  | 50 / 60 Hz at AC 24V                                       |
|                       |                          | Terminal Clamp   | Screw terminal, max. 1.5mm <sup>2</sup>                    |
|                       |                          | Power Consumption  | ≤ 1W @ AC 24V / DC 24V                                     |
|                       | Mechanical Information   | Cable Entry  | 30x15mm, on the backside of the housing                    |
|                       |                          | Sensing Element Position                                 | Inside the housing, bottom of the housing                  |
|                       | Color and Materials      | Housing Cover  | White ABS, RAL9001 (Cream White)                           |
|                       |                          | Housing Bottom   | White ABS, RAL9001 (Cream White)                           |
|                       | Environmental Conditions | Operation Temperature                                    | -25°C...+70°C  |
|                       |                          | Operation Humidity                                       | <85% r.h., no condensation                                 |
|                       |                          | Transport Temperature                                    | -35°C...+70°C  |
|                       |                          | Transport Humidity                                       | < 90% r.h.   |
|                       |                          | Storage Temperature                                      | -10°C...+70°C  |
|                       |                          | Storage Humidity   | < 85% r.h., no condensation                                |
|                       | Norms and Directives     | IP- Rating   | IP20 to IEC60529   |
|                       |                          | Safety Class   | III to EN 60 730   |
|                       |                          | Product Standard 1                                       | Automatic Electric. Controls for household and similar use |
|                       |                          | Product Standard 2                                       | 2009/EN 60 730-1   |
|                       |                          | CE Conformities to                                       | 2004/108/EG Electromagnetic Compatibility EMV              |
|                       |                          | CE Electromagnetic Compatibility Emitted Interference    | 2000/EN60730-1 Emitted Interference                        |
|                       |                          | CE Electromagnetic Compatibility Interference resistance | 2000/EN60730-1 Interference Resistance                     |
|                       |                          | RoHS Compatibility                                       | RoHS 3, Directive 2015/863                                 |
|                       |                          | Operation Climatic Condition                             | IEC 60 721-3-3   |
|                       |                          | Operation Mechanical Condition                           | IEC 60 721-3-2 to class2M2                                 |
|                       |                          | Transport to Climatic Condition                          | IEC 60 721-3-2   |
|                       |                          | Transport Mechanical Condition                           | IEC 60 721-3-2 to class2M2                                 |
|                       |                          | Storage Climatic Condition                               | IEC 60 721-3-1   |
|                       |                          | Storage Mechanical Condition                             | IEC 60 721-3-1 to class2M2                                 |
| Miscellaneous         | Accessories              | Accessory not included in delivery                       | TRA0.A (106mmx106mm backplate)                             |
|                       | Shipping & Handling      | Minimum Order  | 1 box with 1 piece   |
|                       |                          | Package Material   | Rigid Cardboards Packaging                                 |
|                       | Order Notes              | Order Code   | see product range page 1, e.g. CRW9.AA                     |

|   |  |                                      |   |  |
|---|--|--------------------------------------|---|--|
| Modbus Parameters   | Address Number   |                                      | Register Description  |  |
|   | 4  | Software Version                     | actual version  |  |
|   | 6  | Modbus Address                       | Default 254, selectable 1...254   |  |
|   | 8  | Hardware Version                     | actual version  |  |
|   | 11   | Baud Rate autodetection              | 0= OFF ; 1= On  |  |
|   | 15   | Baud Rate, (if autodetection is OFF) | 0= 9600 ; 1= 19.200 ; 2= 38.400 ; 3= 57.600 ; 4= 115.200                    |  |
|   | 34   | Temperature, digital                 | actual value  |  |
|   | 35   | Rel. Humidity                        | actual value  |  |
|   | 41   | Dew Point Value, actual              | actual value  |  |
|   | 42   | Enthalpy Value, actual               | actual value  |  |
|   | 44   | Absolute Humidity, actual            | actual value  |  |
|   | 45   | Temperature, passive                 | actual value  |  |
| BACnet Parameters   | Supported BACnet Objects Types   |                                      |   |  |
|   | analog-value   |                                      |   |  |
|   | device   |                                      |   |  |
|   | Supported BACnet Services  |                                      |   |  |
|   | who-is   |                                      |   |  |
|   | i-am   |                                      |   |  |
|   | object-identifier, object-name, object-type, present-value, units, object-list, vendor-id, vendor-name, system-status, confirmed-service, unconfirmed-services |                                      |   |  |
|   | MSTP Objects   |                                      |   |  |
|   | analog-value   |                                      |   |  |
|   |  | BACnet Address                       | Default 127, selectable 0...127   |  |
|   | AV0  | Baud rate autodetection              | default 0, 0= OFF ; 1= ON   |  |
|   | AV1  | Baud Rate, (if autodetection is OFF) | 0= 9600 ; 1= 19.200 ; 2= 38.400 ; 3= 57.600 ; 4= 115.200                    |  |
|   | AV2  | Humidity Mode                        | 0= Dew Point ; 1= Enthalpy ; 2= Absolute Humidity ;<br>3= relative humidity |  |
|   | AV3  | Protocol                             | 0= Modbus ; 1= BACnet   |  |
|   | AV4  | Temperature                          | actual value (-40...120°C)  |  |
|   | AV6  | Relative Humidity                    | actual value (0...100% rel. Humidity)                                       |  |
|   | AV7  | Absolute Humidity                    | actual value (0...50gr/m³)  |  |
| AV8   | Dew Point  | actual value (-20...80°C)            |   |  |
| AV9   | Enthalpy   | actual value (0...85kJ/kg)           |   |  |
| Device  |  |                                      |   |  |
| device-identifier   |  |                                      |   |  |
| device-name   |  |                                      |   |  |
| The function "Baud Rate autodetection" can only be used during the product is been setup. When the product is working with the BAS, the "Baud Rate autodetection" has to be set to 0= OFF and the actual Baud Rate has to be set. |  |                                      |   |  |
| All Information and technical data are subject to alteration  |  |                                      |   |  |
| Thermokon Asia Pacific  |  |                                      |   |  |
| CRW9- Series (T) V22.1  |  |                                      |   |  |
| Page 3/4  |  |                                      |   |  |

|         |  |
|---------|--|
| Advices | <div><div>Installation Notes</div><div><div><div>Caution</div></div><div>Observe the following general regulation for engineering and implementation:</div><div>Other country specific regulations</div><div>Country-specific regulations</div><div>Local electrical supply authority regulation</div><div>Schematics, cable listings, dispositions, specification and arrangements from the customer or engineering office in charge</div><div>Third party specifications, e.g. general contractors or constructors</div></div></div> |
|         | <div><div>Mounting Advices</div><div><div><div>Caution</div></div><div></div><div></div><div></div><div></div></div></div>   |
|         | <div><div>Disposal Notes</div><div><div></div><div>The device is considered an electronic device for disposal in terms of the EUROPEAN DIRECTIVE 2012/19/EU.</div><div>The device may not be disposed as domestic garbage.</div><div>The device must be disposed through channels provided for this purpose.</div><div>It is mandatory to comply with local currently applying laws and regulations.</div></div></div>  |
|         | <div><div>Setup</div><div>When the sensor is connected to the network and power supply, the sensor will detect the connected communication system.</div><div>The sensor will than synchronize with the connected building automation system (BAS).</div></div>   |

|                 |  |
|-----------------|--|
| Accuracy Curves | <div><div></div><div><div><div><div><div>tolerance (%)</div><div>Relative Humidity</div><div>Measuring Range 0...100%</div><div>Typical tolerance <math>\pm 2\%</math></div></div><div></div></div><div><div><div>tolerance (%)</div><div>Absolute Humidity</div><div>Measuring Range 0...50gr/m³</div><div>Typical tolerance <math>\pm 2\%</math></div></div><div></div></div><div><div><div>tolerance (%)</div><div>Enthalpy</div><div>Measuring Range 0...65 J/kg</div><div>Typical tolerance <math>\pm 2\%</math></div></div><div></div></div><div><div><div>tolerance (%)</div><div>Dew Point</div><div>Measuring Range -20...80°C</div><div>Typical tolerance <math>\pm 2\%</math></div></div><div></div></div></div></div></div> |
|-----------------|--|

|                     |  |
|---------------------|--|
| Dimensional Drawing | <div><div></div></div> |
|---------------------|--|

| Connections & Settings | <div><div><table><tr><th colspan="6">Terminal Connection</th></tr><tr><th>T1</th><th>T2</th><th>T3</th><th>T4</th><th>T5</th><th>T6</th></tr><tr><td>UB+<br/>24V AC/DC</td><td>GND</td><td>RS485 C-</td><td>RS485 C+</td><td>n.A.</td><td>n.A.</td></tr></table></div></div> | Terminal Connection |          |      |      |  |  | T1 | T2 | T3 | T4 | T5 | T6 | UB+<br>24V AC/DC | GND | RS485 C- | RS485 C+ | n.A. | n.A. |
|------------------------|--|---------------------|----------|------|------|--|--|----|----|----|----|----|----|------------------|-----|----------|----------|------|------|
| Terminal Connection    |  |                     |          |      |      |  |  |    |    |    |    |    |    |                  |     |          |          |      |      |
| T1                     | T2   | T3                  | T4       | T5   | T6   |  |  |    |    |    |    |    |    |                  |     |          |          |      |      |
| UB+<br>24V AC/DC       | GND  | RS485 C-            | RS485 C+ | n.A. | n.A. |  |  |    |    |    |    |    |    |                  |     |          |          |      |      |